


## THREE EF MODELS WITH RETURN CIRCULATION

DRAIN PIPES TO TERMINATE NO MORE THAN 6" (15.2 cm) ABOVE FLOOR WITH DRAIN.

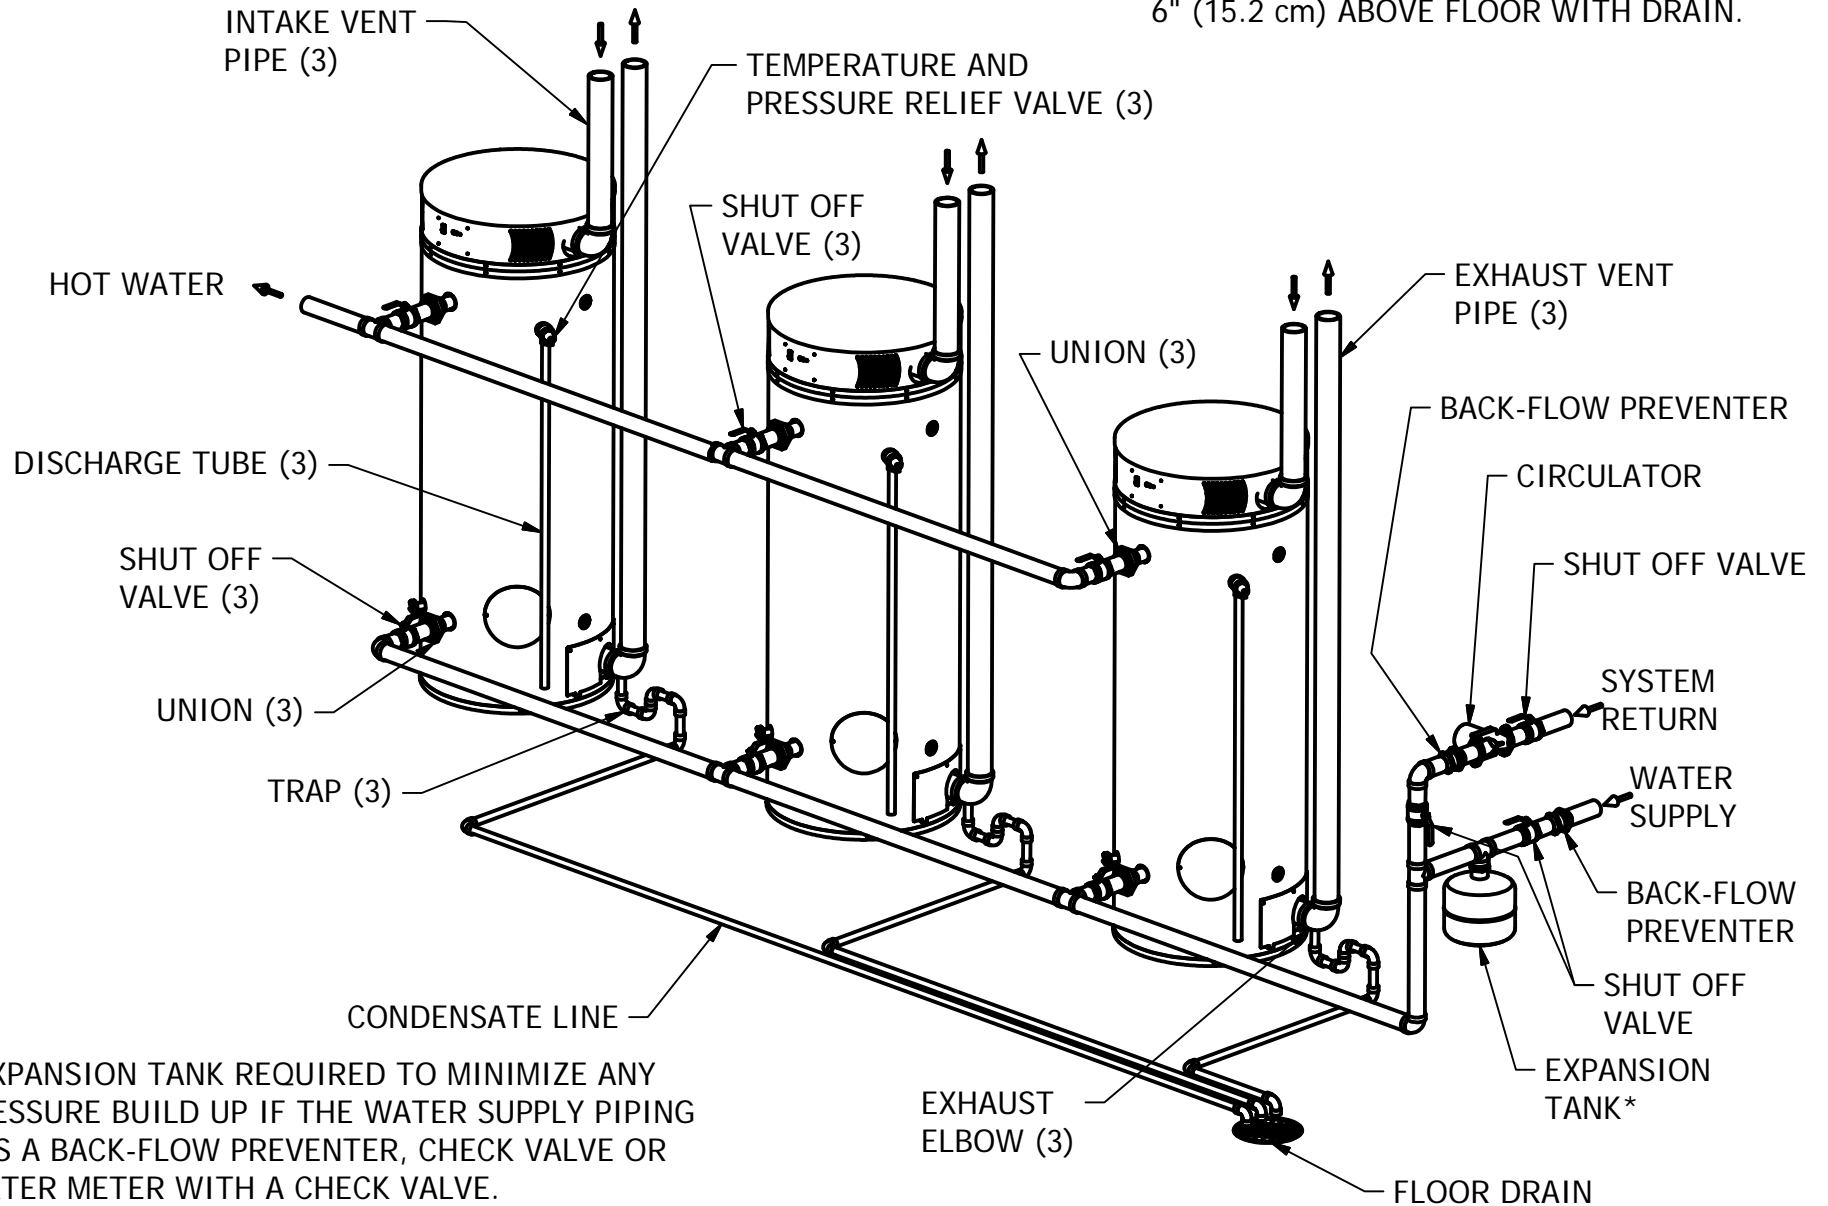

\*EXPANSION TANK REQUIRED TO MINIMIZE ANY PRESSURE BUILD UP IF THE WATER SUPPLY PIPING HAS A BACK-FLOW PREVENTER, CHECK VALVE OR WATER METER WITH A CHECK VALVE.