


ONE PDX2 W/ INTAKE VENT AND EXHAUST VENT

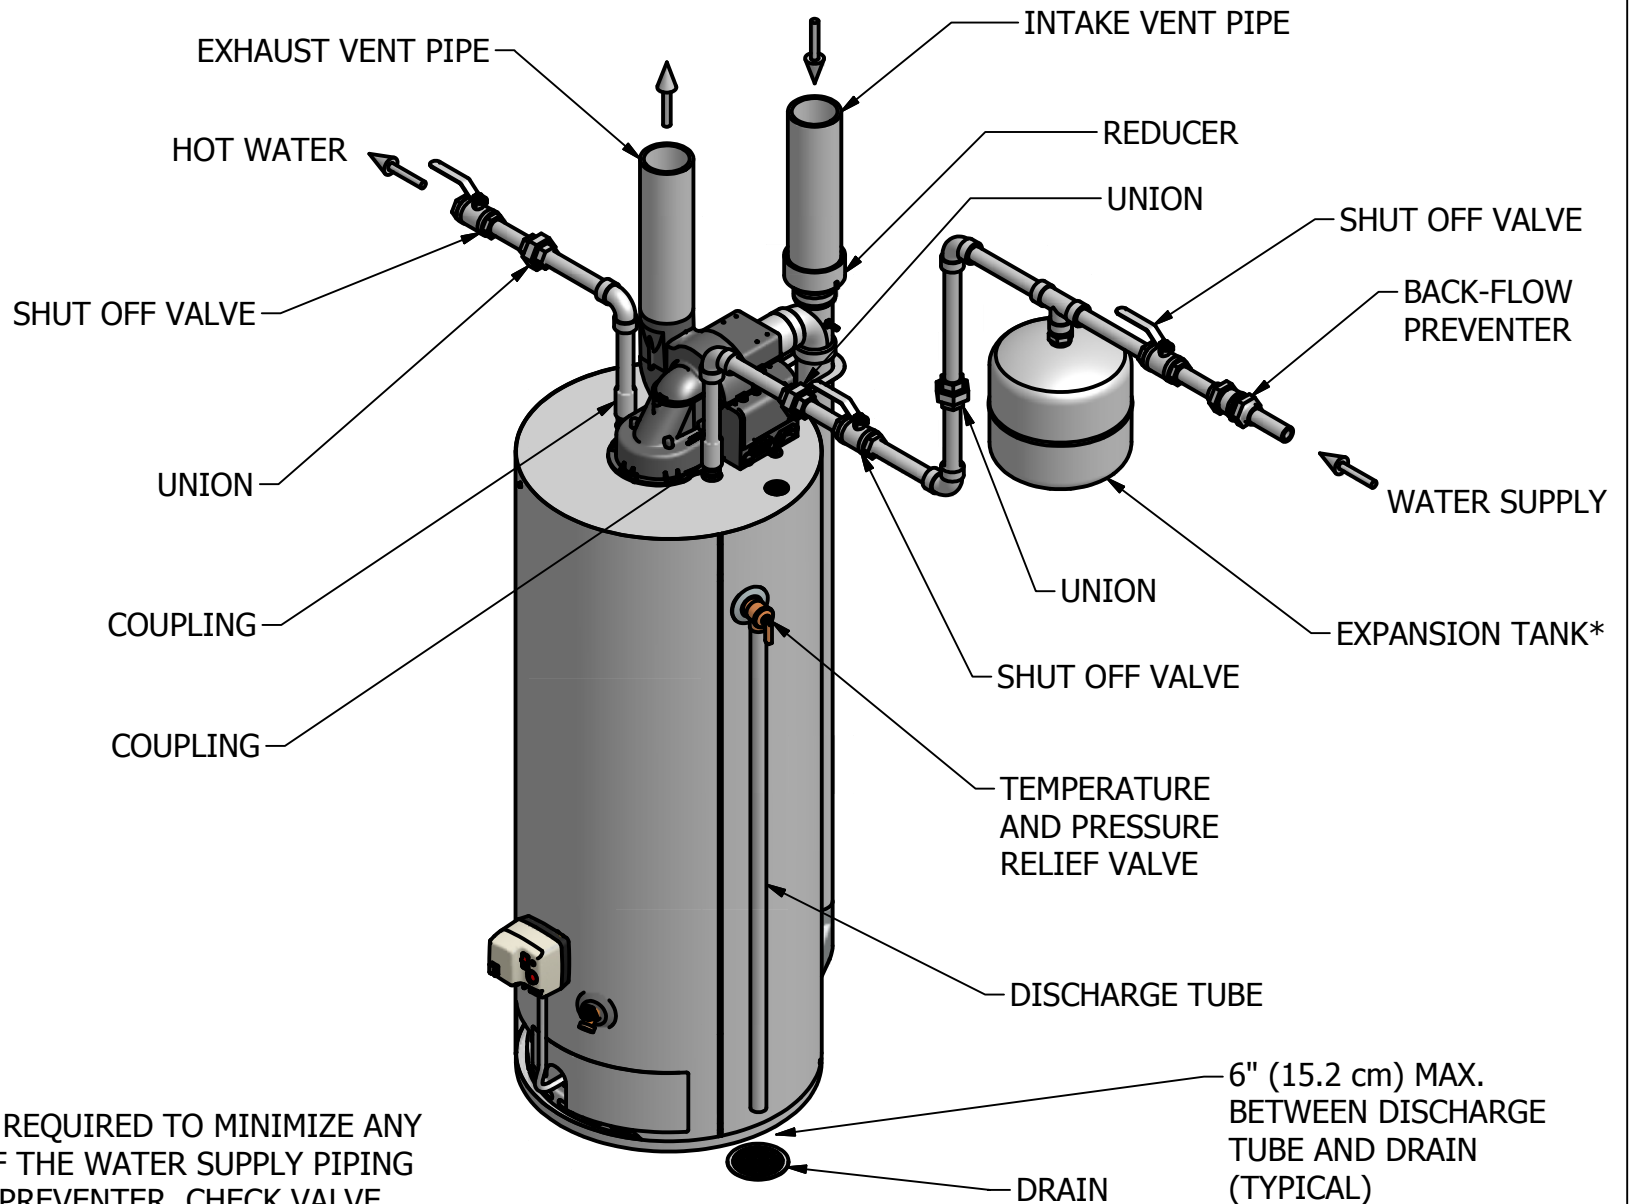

*EXPANSION TANK REQUIRED TO MINIMIZE ANY PRESSURE BUILD IF THE WATER SUPPLY PIPING HAS A BACK-FLOW PREVENTER, CHECK VALVE OR WATER METER WITH A CHECK VALVE.